

Contractor Service Tips


Tip Card
4

SERVICE VALVES

The typical service valve is composed of four essential parts:

- Line connection
- Service opening or gauge port
- Valve stem
- Compressor connection
- Packing gland nut

SERVICE VALVE - FRONT-SEATED

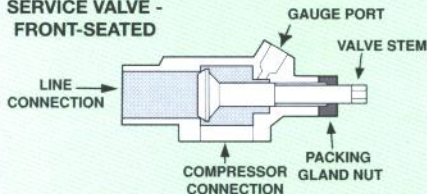

When the valve is back-seated (the stem is all the way out), the gauge port is closed and the valve is open, allowing refrigerant to flow through the system. If the valve is front-seated (stem all the way in), the gauge port is open to the compressor connection and the refrigerant line (suction or discharge) connection is closed. In order to read the pressure while the valve is open, the valve should be back-seated, then turned once or twice to slightly open all three connections: the gauge port, line, and compressor. This allows both the compressor and refrigerant line to be open and vapor pressure to flow through. At the gauge port, you can check system pressure and charge or reclaim refrigerant.

When brazing a service valve:

Make sure the valve is mid-seated before brazing. The heat from brazing a fully front-seated or back-seated valve can cause the button of the valve stem (inside the valve) to "weld" to the seating area on the inside of the body of the valve.


A technique called "wet-ragging" can also help. Soak a rag in cold water and wrap it around the service valve before brazing. Make sure water does not enter the valve.

When opening a service valve:

Make sure the service valve is secure (in a vice, bolted down, or attached with the rotalock connection) before attempting to open the packing nut or valve stem. *Verify whether the valve employs a packing gland nut (many Copeland service valves do).* The packing nut helps to ensure a leak free seal. It is typically brass and is

found at the base of the valve stem. It must be loosened by a quarter to a full turn before opening the valve. Make sure to tighten the nut when you are finished manipulating the valve stem.

MID-SEATED



Use the right tools! Service valves on Copeland condensing units have a torque requirement of 22-25 ft lbs. in order to have a leak free seal when the units leave our plant. You will only be able to open a service valve with the appropriately sized service valve wrench. Do not attempt to open a service valve with an adjustable wrench. You may round the valve stem edges and the valve will be useless.

If all else fails and the stem appears stuck, *lightly* tap the end of the valve stem with a hammer and the valve should open. **NOTE: If the packing gland nut is not loosened the valve could be damaged.**


Primesource


EMERSON
Climate Technologies

Form No. 2002-122
©2002 Copeland Corporation
Printed in U.S.A.

Copeland is a registered trademark and PrimeSource is a service mark of Copeland Corporation. Emerson Climate Technologies is a registered trademark and a service mark of Emerson Electric Co.